



SOUND ABSORPTION
ASTM C 423

Test Date	08/03/15	
ATI No.	E9775.01F	
Client	Burch Fabrics	
Specimen	Series/Model: Unison Suede over Owens Corning Type 475-FRK 1" duct board	
Operator	Eric A. Thompson	
Sample Area	6.69 m ²	
Mounting Type	Type A	
	Empty	Full
Temp C	22	21
RH %	51	49
B.P. (mb)	1010	

Freq (Hz)	Empty Room Absorption (m ²)	Uncertainty	Full Room Absorption (m ²)	Uncertainty	Absorption Coefficient	Relative Uncertainty
80	4.34	0.395	4.54	0.237	0.03	0.069
100	4.52	0.351	4.71	0.247	0.03	0.064
125	4.62	0.236	4.99	0.380	0.06	0.067
160	4.13	0.082	4.79	0.184	0.10	0.030
200	4.21	0.124	5.33	0.162	0.17	0.030
250	4.65	0.065	6.37	0.056	0.26	0.013
315	4.91	0.041	7.59	0.064	0.40	0.011
400	5.07	0.046	9.00	0.029	0.59	0.008
500	5.03	0.047	10.02	0.232	0.75	0.035
630	4.58	0.032	10.53	0.013	0.89	0.005
800	4.56	0.032	10.99	0.025	0.96	0.006
1000	4.65	0.020	11.44	0.008	1.02	0.003
1250	5.18	0.030	12.17	0.027	1.04	0.006
1600	5.21	0.008	12.43	0.013	1.08	0.002
2000	5.11	0.014	12.28	0.045	1.07	0.007
2500	5.38	0.008	13.13	0.118	1.16	0.018
3150	6.00	0.010	13.59	0.011	1.13	0.002
4000	6.43	0.004	14.44	0.011	1.20	0.002
5000	7.14	0.012	15.71	0.006	1.28	0.002


NRC Rating **0.80** *(Noise Reduction Coefficient)*
SAA Rating **0.78** *(Sound Absorption Average)*

- Notes:**
- 1) The NRC rating is the arithmetic average of the sound absorption coefficients at 250, 500, 1000, and 2000 hertz. The average is rounded to the nearest multiple of 0.05.
 - 2) The SAA rating is the arithmetic average of the sound absorption coefficients at the frequencies ranging from 200 to 2500 hertz. The average is rounded to the nearest multiple of 0.01.



SOUND ABSORPTION ASTM C 423

Test Date	08/03/15	
ATI No.	E9775.01F	
Client	Burch Fabrics	
Specimen	Series/Model: Unison Suede over Owens Corning Type 475-FRK 1" duct board	
Operator	Eric A. Thompson	
Sample Area	6.69 m ²	
Mounting Type	Type A	
	Empty	Full
Temp C	21.9	21.3
RH %	51	49
B.P. (mb)	1010	

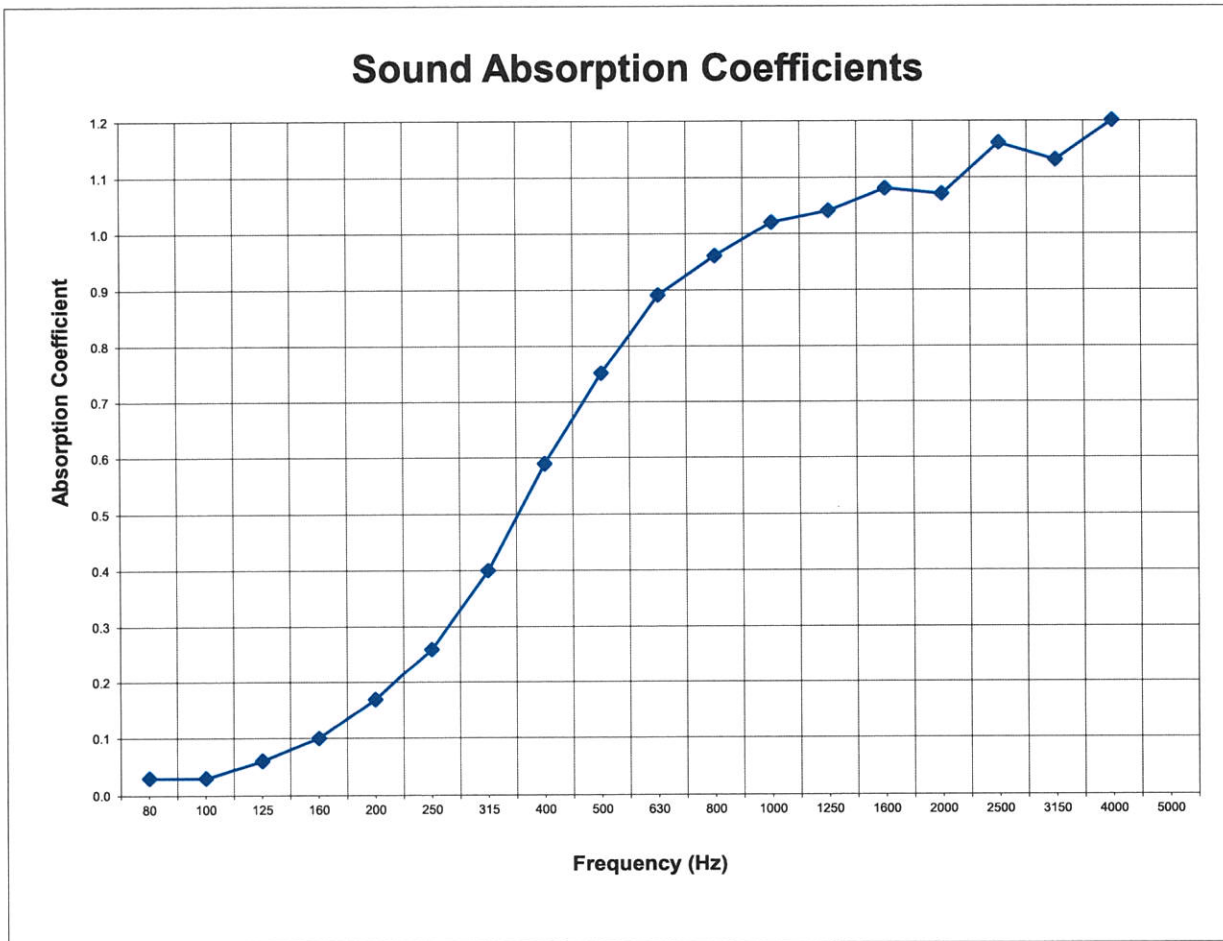



Installed Specimen Unison Suede